


REV. May 1, 2020
REV. Jul. 2, 2018

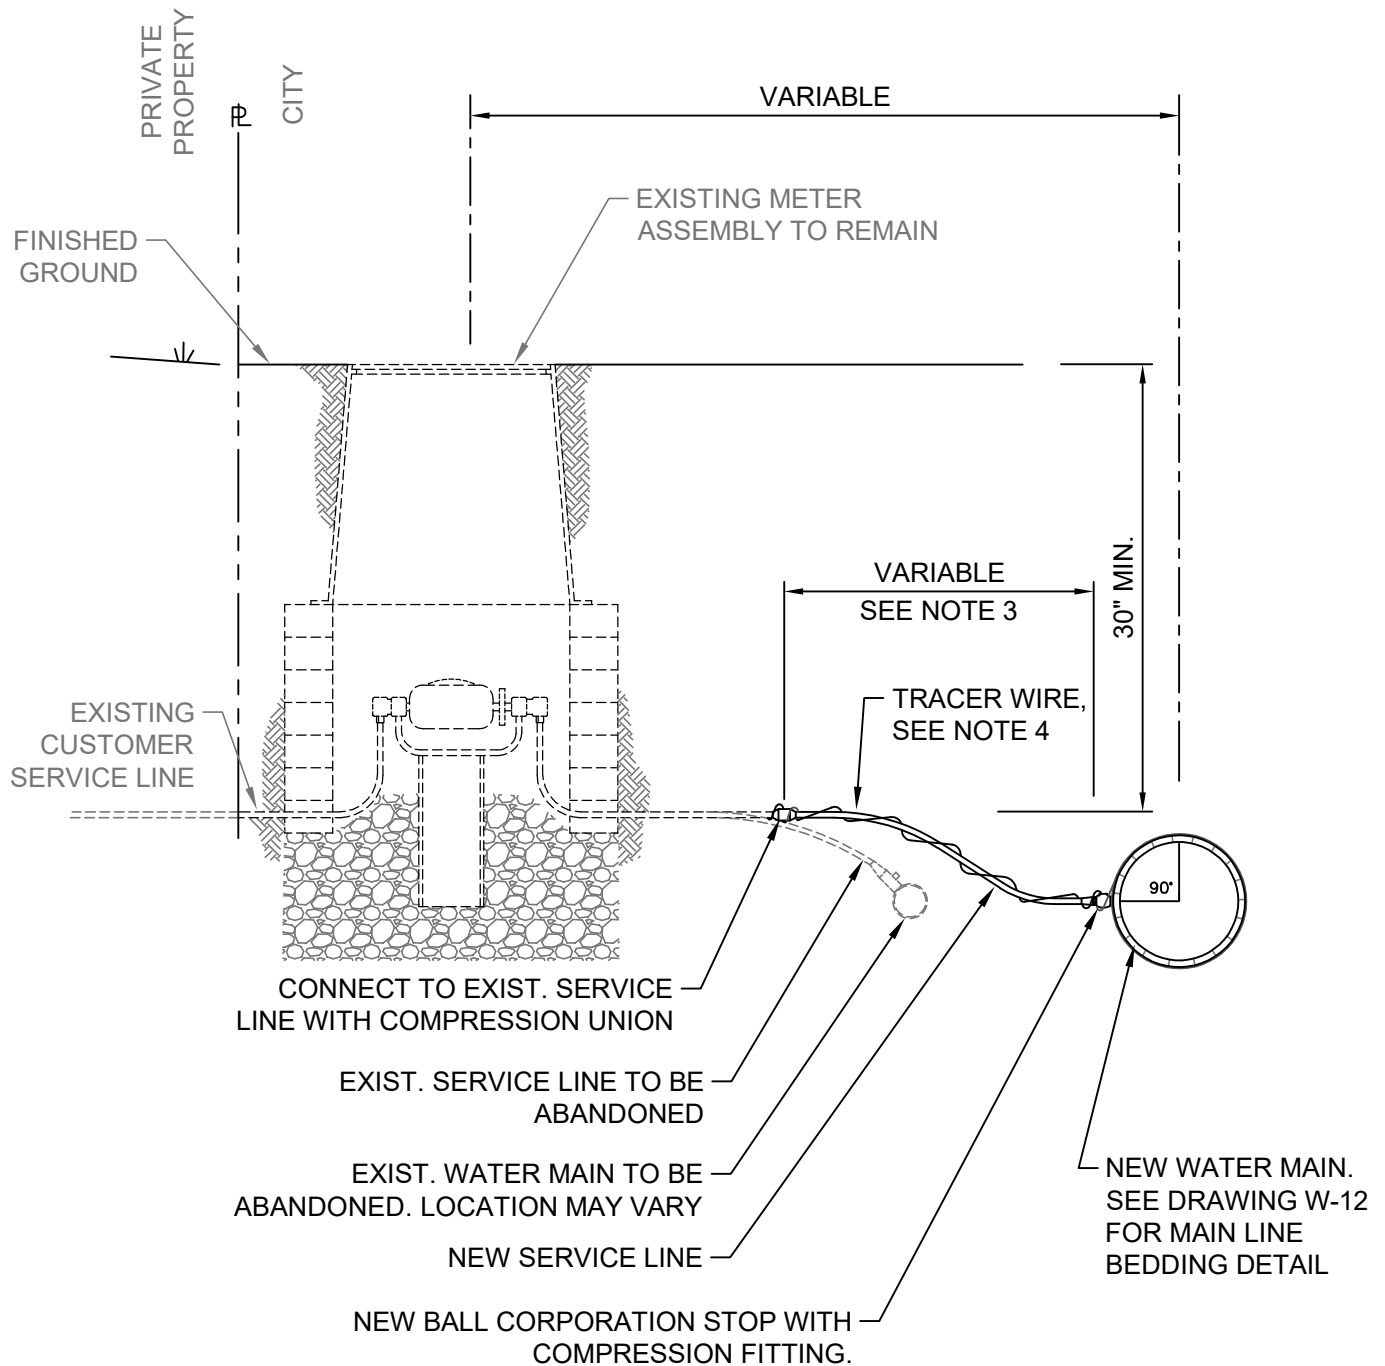

NOTES:

1. ALL SERVICE LINE CONNECTIONS AND FITTINGS SHALL BE COMPRESSION.
2. SEE CONSTRUCTION PLANS FOR WATER MAIN AND SERVICE LINE SPECIFICATIONS.
3. CONNECT NEW SERVICE LINE TO NEAREST ACCESSIBLE POINT ON EXISTING SERVICE LINE.
4. INSTALL TRACER WIRE ON NON-METAL SERVICE LINES: WRAP WIRE THREE (3) TIMES AROUND WATER MAIN. SECURE TO SERVICE LINE AT MAX. 3' INTERVALS WITH VINYL ELECTRICAL TAPE OR APPROVED METHOD. ENSURE WIRE IS SECURELY ATTACHED TO CORP STOP. AT CONNECTION TO EXISTING SERVICE, BARE END AND SECURE TO EXISTING TRACER WIRE IF PRESENT. IF NO EXISTING TRACER WIRE WRAP AROUND EXISTING SERVICE LINE FIVE (5) TIMES AND SECURE. SEE TECHNICAL SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

NOT TO SCALE

CITY of
STAUNTON,
VIRGINIA

TYPE II-B CONNECTION
RECONNECT WATER SERVICE TO EXISTING
SERVICE LINE

DRAWING
NUMBER
W-8B