


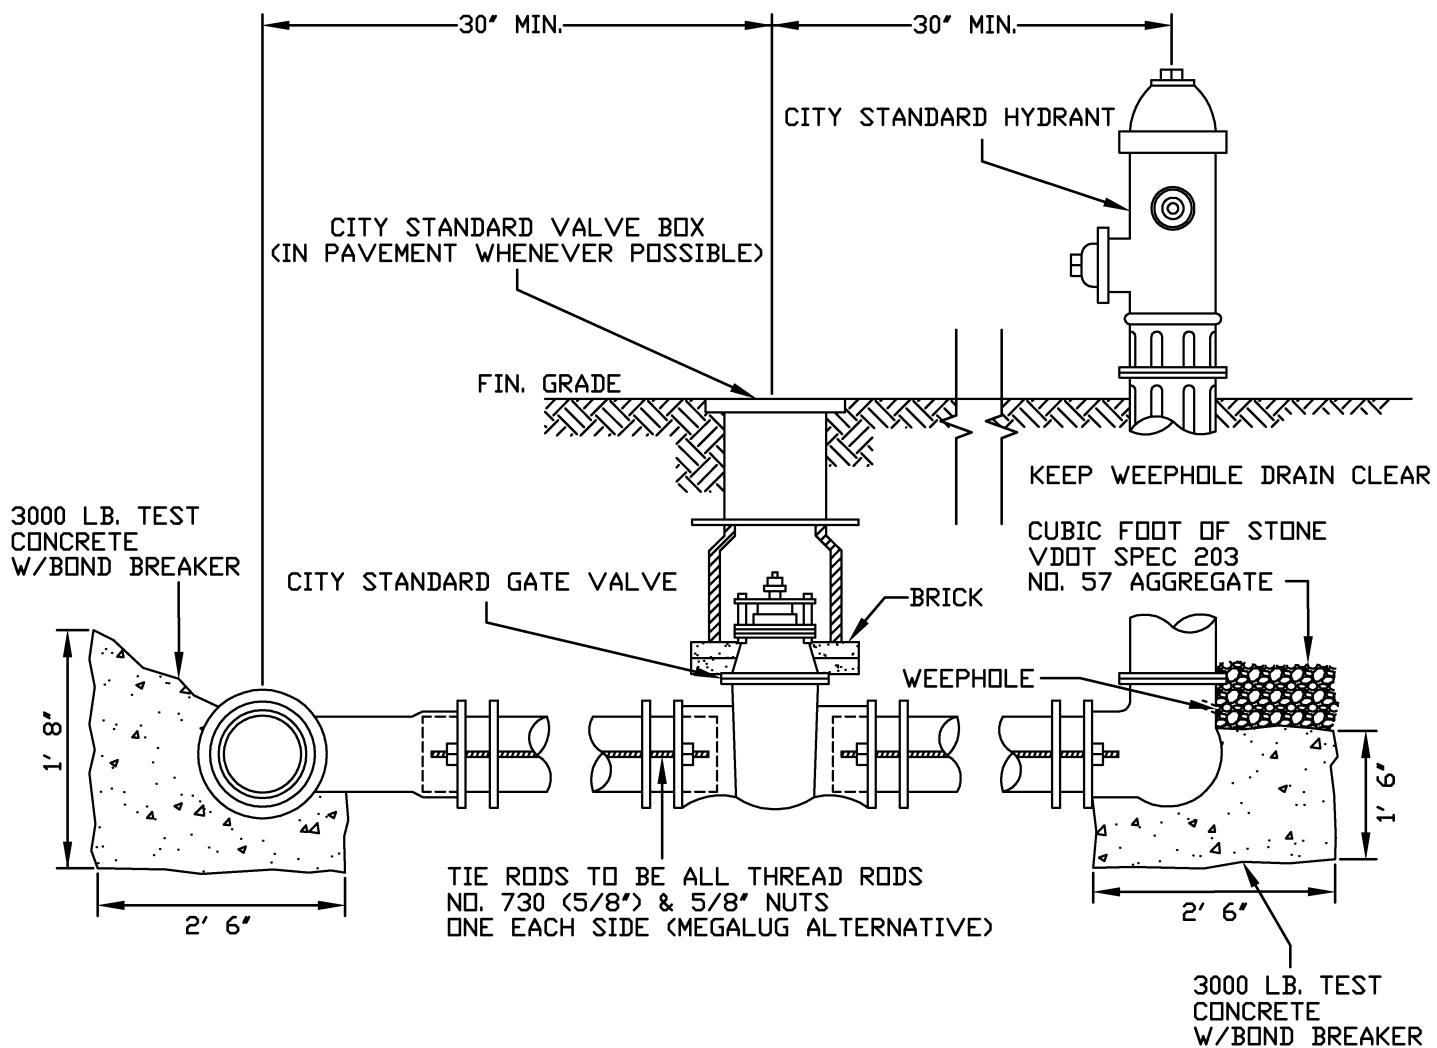

NOTES:

LOCATE VALVE IN PAVEMENT WHERE APPLICABLE

WEEP HOLES SHALL BE LOCATED ABOVE THE SEASONAL WATER TABLE

CITY OF
STAUNTON, VA

**STANDARD FIRE HYDRANT
ASSEMBLY**

Draw No.
W-10